

FPS-ACRYLIC

1. Unique identification code of the product-type:

FPS-Acrylic

2. Type, batch or serial no. or any other element allowing identification of the construction product as required pursuant to article 11(4):

See label for batch number

2.1 FPS-Acrylic is supplied in 300 ml foils, 310 ml cartridges, 380 ml cartridges and 600 ml foils.

2.2 In accordance with article 11(4) all products are supplied with product code, date of manufacture and with all manufacturing processes traceable through ISOGLOBAL held in the product technical files.

3. Intended use or uses of the construction product, in accordance with the applicable harmonized technical specification, as foreseen by the manufacturer, and in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104 (penetration seals) and EAD 350141-00-1106 (linear joint seals).

3.1 The intended use of system FPS-Acrylic is to reinstate the fire resistance performance of gaps, joints and penetrating services in and between flexible, timber and rigid wall constructions, and rigid, composite and timber floor constructions, including between timber door/window, aluminum/steel frames and substrates.

3.2 The specific elements of construction that the system FPS-Acrylic may be used to provide a gap or joint seal or penetration seal in, are as follows:

Flexible walls: The wall must have a minimum thickness of 75 mm and comprise of steel studs lined on both faces with minimum 1 layer of 12.5 mm thick boards ¹⁾

Timber walls: The wall must have a minimum thickness of 100 mm and comprise solid wood or crosslaminated timber.

Rigid walls: The wall must have a minimum thickness of 75 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m³ ¹⁾.

Rigid floors: The floor must have a minimum thickness of 150 mm ²⁾ and comprise aerated concrete or concrete with a minimum density of 650 kg/m³.

Timber floors: The floor must have a minimum thickness of 150 mm and comprise solid wood or crosslaminated timber. The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- ¹⁾ Minimum wall thickness is dependent on approvals specified in the ETAs Annex A.
²⁾ Composite floors can be thinner, please refer to the installation instructions.

3.3 The system FPS-Acrylic may be used to provide a penetration seal with specific single insulated and uninsulated metal and plastic pipes, and with specific electrical cables and conduits, single or in a bundle and may also be used to provide a linear joint or gap seal with specific supporting constructions and substrates (for details see ETA 22/0657 and 22/0659, Annex A).

The maximum permitted joint/gap width for system FPS-Acrylic is 100 mm.

The maximum movement capability of system FPS-Acrylic is 12.5%

Services in floors should be supported at maximum 500 mm from the top face. Services in walls should be supported at maximum 300 mm from both faces of the wall.

3.4 The provisions made in this DoP are based on an assumed working life of the FPS-Acrylic of 10 years, however provided that the conditions laid down in the manufacturers' instructions and datasheet for the packaging/transport/ storage/ installation/use/repair are met the assumed working life for FPS-Acrylic for internal conditions without exposed to UV or moisture is 30 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3.5 Type Z2: Intended for uses in internal conditions with humidity lower than 85 % RH excluding temperatures below 0 °C, without exposure to rain or UV.

4. Name, registered trade name or registered trade mark and contact address of the manufacturer as required pursuant to article 11(5):

ISOGLOBAL

Rellerriege 26

D-33161 Hövelhof

5. Where applicable, name and contact address of the authorized representative whose mandate cover the tasks specified in Article 12(2):

Not applicable

6. System or systems of assessment and verification of consistency of performance of the construction product as set out in annex V:

AVCP-System 1

7. In case of the declaration of performance concerning a construction product covered by a harmonized standard:

Not applicable

8. In case of the declaration of performance concerning a construction product for which a European Technical Assessment has been issued:

This Declaration of Performance has been prepared in accordance with the guidelines set out within EAD 350141-00-1106, linear joint seals and EAD 350454-00-1104 penetration seals.

ETA 22/0659 issued on 26/09/2022 and ETA 22/0657 issued on 26/09/2022 prepared by ETA-Danmark A/S. CoC 2531-CPR-CXO10384 issued on 24/10/2022 prepared by DBI Certification, notified body No. 2531.

9. Declared performance:

Product –type: Intumescent sealant	Intended use: Linear Joint & Gap Seal, Penetration Seal	
Essential characteristics	Performance	Test Standard
Reaction to Fire	B-S1-d0	EN 13501-1
Resistance to Fire	22/0659 & 22/0657 Annex A	EN 13501-2
Air permeability (material property)	22/0657 Annex B	EN 1026:2000
Water permeability	Not water proof	ISO 7326
Release of dangerous substances	As the manufacture we declare that there is no release of dangerous substances during the installation or use of this product. See safety data sheets and emission test reports.	
Mechanical Resistance and stability	NPD	EOTA TR 001:2003
Resistance to impact/movement	NPD	EOTA TR 001:2003
Airborne sound insulation	Rw = 62dB @ 12 mm depth single sided w/o backing	EN 10140-2
Impact sound insulation	NPD	EN 10140-3
Thermal properties	0,0845 W/mK (+/- 3%) & 20 mm depth	EN 12664, EN12667 or EN12939
Water vapor permeability	NPD	EN ISO 12572, EN 12086
Durability and serviceability	Z ₂	ISO 8339:2005, ISO 9046:2004 & ISO 7389
Tensile Properties	Elongation at break ≥100% & 23°C	ETAG 026 pt2 B.13.5 ISO 8339:2005
Elastic recovery	7.5% Elongation 50% recovery, M2 Mortar	ETAG 026 pt2 B.13.5 ISO 7389:2003
Adhesion properties	No failure, M2 Mortar	ETAG 026 pt2 B.13.5 ISO 9046:2005

10. The performance of the product identified in points 1 and 2 is in conformity with the performance in point 9.

This declaration of performance is issued under the sole responsibility of the manufacturer identified in point 4.


Signed on the behalf of the manufacturer by:

Anders B. Brejnholt , Busines Unit Manager

(name and function)

Hövelhof, 01.11.2022

Place and date of issue

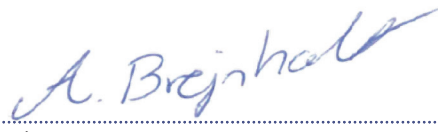

Signature